



Young Regulator Co.

7100 Krick Rd • Walton Hills, OH 44146

P: 440-232-9700 • F: 440-232-8266

www.youngregulator.com

Submit 3040A 10-2015

Model 3040 and 3040P

Medium Pressure
Rectangular Control Damper

Standard Construction:



- Frame:** 3-1/2" x 5/8" (88.9 x 15.9 mm) x 16 gauge rollformed galvanized steel hat section with welded corners.
- Blades:** 16 ga. rollformed galvanized steel on 6" (152.4 mm) centers.
- Bearings:** Permanently lubricated oilite bronze, press fit into frame.
- Axles:** 1/2" dia. (12.7 mm) plated steel.
- Linkage:** Commercial grade, brass pivots, machine riveted to blade.
- Linkage Tie Rod:** 1/4" dia. (6.4 mm) plated steel.
- Operator Shaft:** 6" x 1/2" dia. (152 mm x 12.7 mm) plated steel.
- Finish:** Mill galvanized.
- Minimum Damper Size:** 6"w x 12"h (152 mm x 304.8 mm)
- Maximum Damper Size:** Single Section: 48"w x 72"h (1,219 mm x 1,828 mm)
Multi Section: unlimited

Options:

- Seals:** Vinyl or stainless steel blade seals
Flexible stainless steel jamb seals
- Operators:** Motor mounting - factory furnished or by others
Manual quadrant
- Finish:** Painted finishes
- Face & Bypass:** Right angle and straight line mixing dampers

Notes:





- All Dampers are fabricated 1/4" under listed sizes unless specified "actual or exact".
- Dampers must be installed square and free from racking.
- Dampers with multiple sections in both width and height require structural supports (by others). Young Regulator recommends that large openings be divided with structural members such that dampers span either the width or height of each opening between structural members with a single section.
- All dampers must be installed with blades running horizontally.
- Connect all damper motors to linkage side of operator blade or to operator shaft.
- Consult factory of application involves static pressures in excess of 2.5 inches w.g.

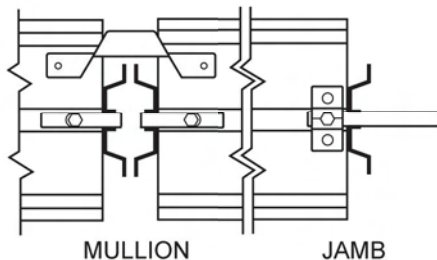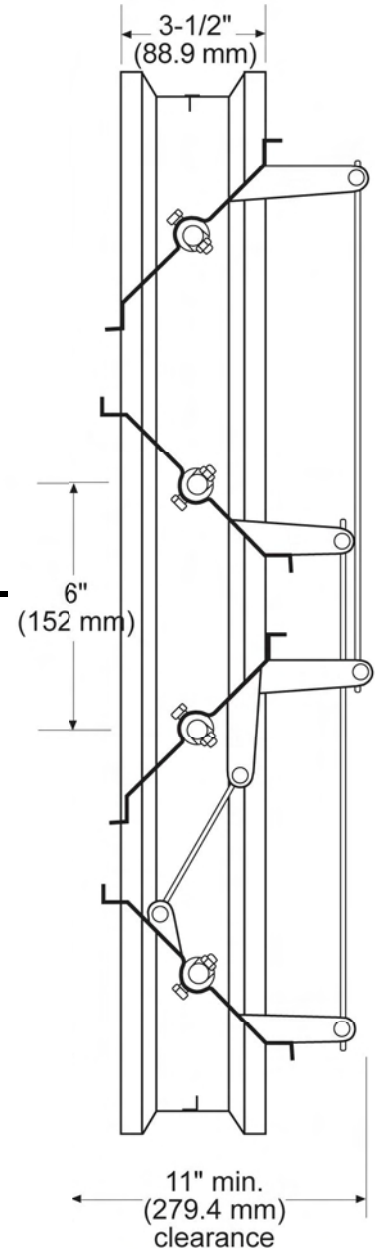

QUANTITY	WIDE	HIGH	NOTES
			www.youngregulator.com/products/3040a.pdf
PROJECT		LOCATION	
CONTRACTOR		DESIGN SPECIFIER	




Pressure drop testing was conducted by an independent laboratory in accordance with the AMCA Standard 500-D, Fig. 5.3 ductwork upstream & downstream

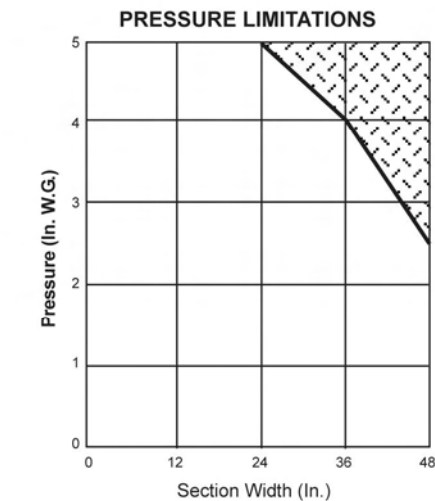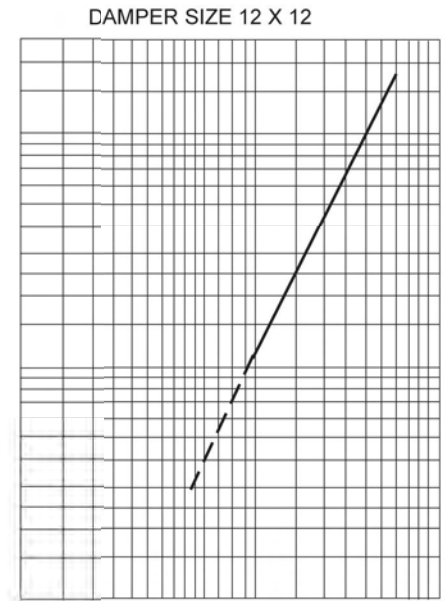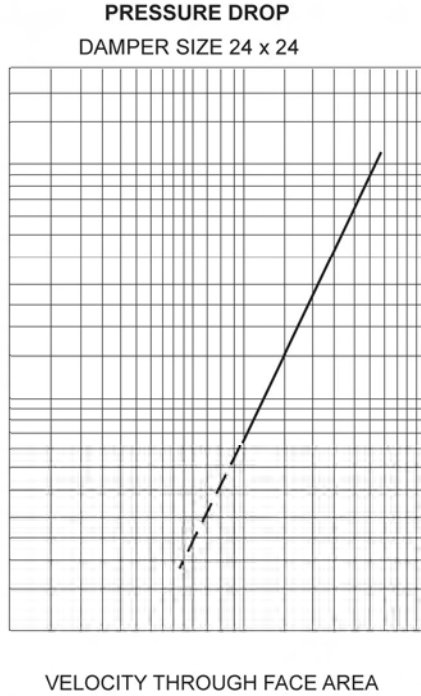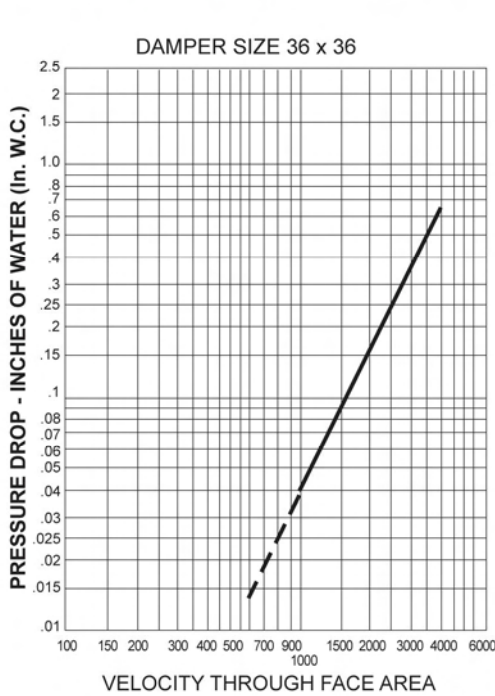

Pressure & Velocity Limitations presented in the adjoining graphs are conservative in order to avoid mis-applications.

Please contact factory for application guidance if your requirements exceed published limitations.

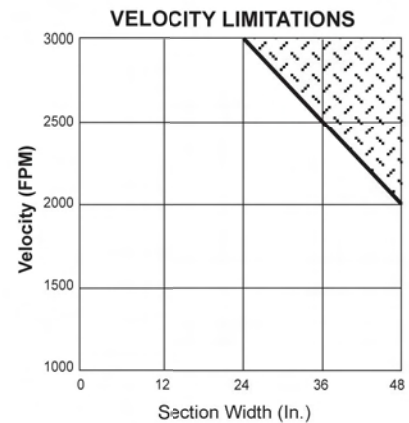

Leakage Performance test was conducted by an independent laboratory in accordance with AMCA Standard 500-D and is expressed as CFM/SQ. FT. of damper face area. Damper requires both blade edge seals and jamb seals to achieve leakage performance depicted.

